



Franklin Electric
FUELING SYSTEMS



CABLE TIGHT™

CERTIFICATIONS GUIDE

CABLETIGHT™ SYSTEM CERTIFICATIONS

Use this guide to aid in securing installation permits, passing regulator inspections, or obtaining a deviation for the CableTight™ wire management system in your local market.

STANDARDS FOR SAFETY

CableTight™ system conduit and fittings hold the UL Certificates of Compliance per the component diagram and table below. Copies of all Certificates of Compliance can be found at the end of this document. CableTight™ ¾" and 1" flexible conduit is constructed of HDPE and is available in 1,000 ft or 1,500 ft pre-loaded reels.



Standard	Description	System Components	Certificate #
UL651A	Standard for safety for Schedule 40 and 80 HDPE conduit	HDPE conduit	20170512-E487209
UL514B	Standard for safety for conduit, tubing, cable fittings	Acetal fittings	E528671-20230629

NATIONAL ELECTRICAL CODE


The CableTight™ system allows you to create seamless, watertight connections between electrical conduit and containment. This eliminates buried glued and threaded joints which can lead to liquid penetration. HDPE constructed components are used in the CableTight™ process. Before the NEC NFPA-70 2017 revision, HDPE was not listed in hazardous (classified) locations.

Specific NEC NFPA 70 2017 updates which allow the use of HDPE conduit include:

- 501.10(A)(1)(a) - Class I, Division 1, Underground Wiring
- 511.8 - Commercial Garages, Underground Wiring
- 514.8 - Motor Fuel Dispensing Facilities, Underground Wiring

Is the CableTight™ system approved in your state? What to do next.

Use the map below to determine if your state of operation has adopted the NEC NFPA 70-2017 or NFPA 70-2020. If it has, it may be suitable to install the CableTight™ system without further action. Check your local regulatory contact for guidance. For all other states, use this certification packet to obtain a deviation to allow HDPE conduit per the NEC NFPA 70-2020 revision. As of February 1, 2023, the 2020 NEC is in effect in twenty-five states, the 2017 NEC is in effect in seventeen, the 2014 NEC is in effect in two states and the 2008 NEC is in effect in two states.

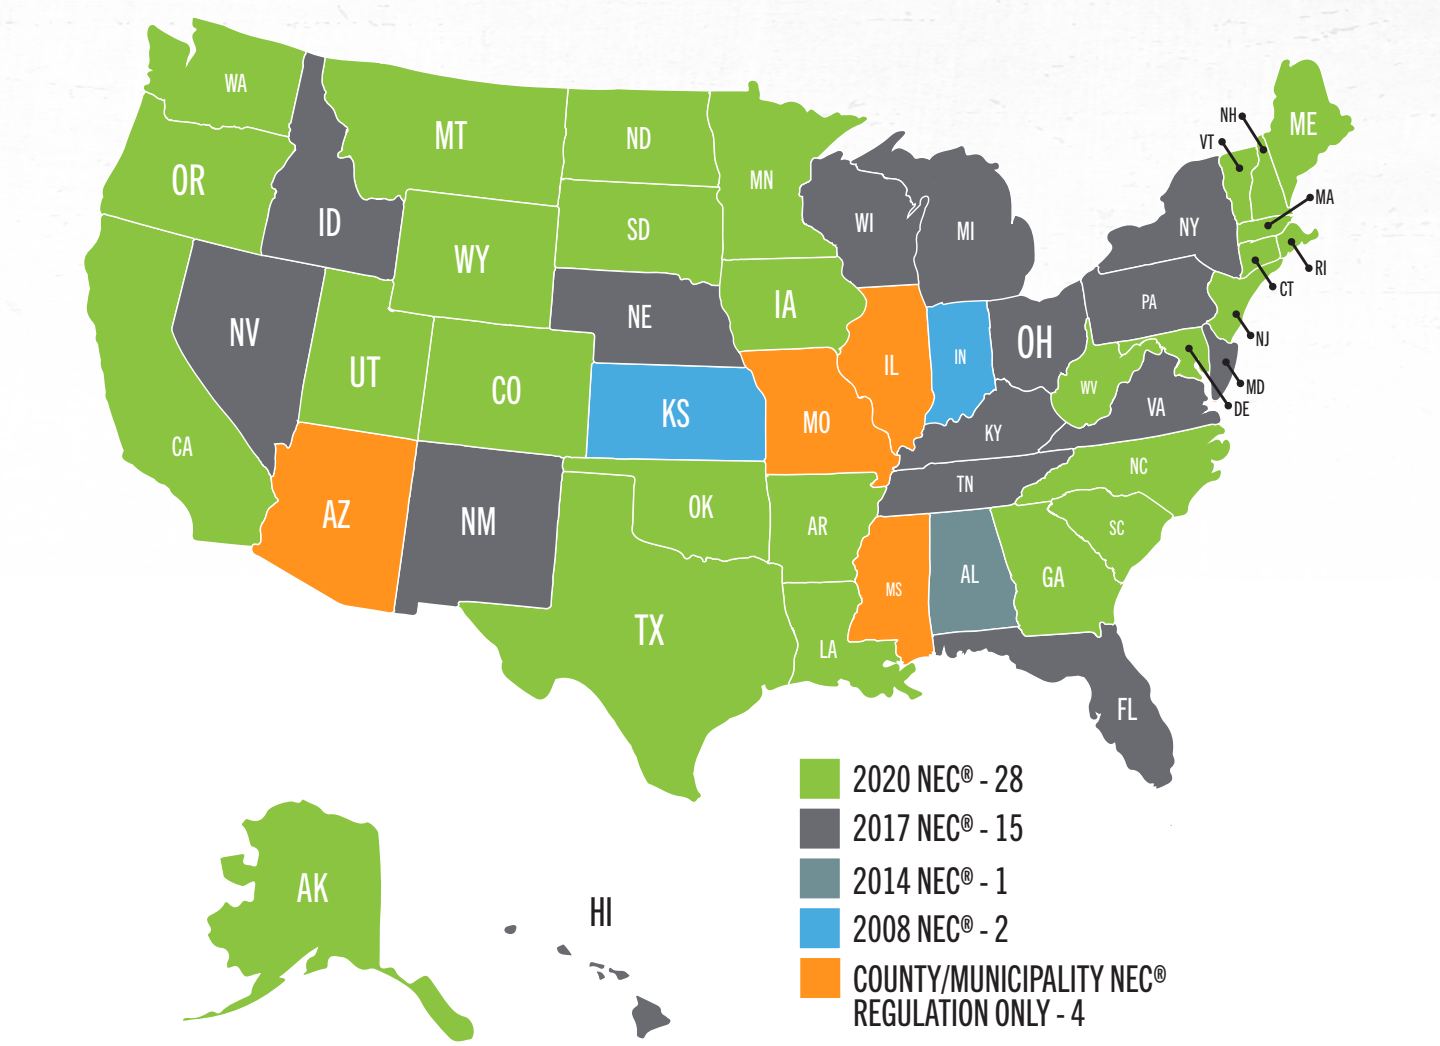

As of 7/19/23. Subject to change. See NFPA.org for latest map.

Please find copies of all Certificates of Compliance on the following pages.

AUTHORIZATION TO MARK

This authorizes the application of the Certification Mark(s) shown below to the models described in the Product(s) Covered section when made in accordance with the conditions set forth in the Certification Agreement and Listing Report. This authorization also applies to multiple listee model(s) identified on the correlation page of the Listing Report.

This document is the property of Intertek Testing Services and is not transferable. The certification mark(s) may be applied only at the location of the Party Authorized To Apply Mark.

Applicant:	Dura-Line Corporation	Manufacturer:	Dura-Line Corporation
Address:	11400 Parkside Drive, Suite 300 Knoxville, TN 37934	Address:	860 Garden St. Elyria, OH 44035
Country:	USA	Country:	USA
Contact:	Richard Hicks / Arturo Valencia	Contact:	Bryan Andrassy
Phone:	865-223-5109 / 865-223-5058	Phone:	440-284-1171 / 216-870-0340
FAX:	865-223-5085	FAX:	440-322-1001
Email:	richard.hicks@duraline.com / arturo.valencia@duraline.com	Email:	bryan.andrassy@duraline.com
Party Authorized To Apply Mark:	Same as Manufacturer		
Report Issuing Office:	Cortland, NY 13045		
Control Number:	4004042	Authorized by:	 for Dean Davidson, Certification Manager



This document supersedes all previous Authorizations to Mark for the noted Report Number.

This Authorization to Mark is for the exclusive use of Intertek's Client and is provided pursuant to the Certification agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this Authorization to Mark. Only the Client is authorized to permit copying or distribution of this Authorization to Mark and then only in its entirety. Use of Intertek's Certification mark is restricted to the conditions laid out in the agreement and in this Authorization to Mark. Any further use of the Intertek name for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. Initial Factory Assessments and Follow up Services are for the purpose of assuring appropriate usage of the Certification mark in accordance with the agreement, they are not for the purposes of production quality control and do not relieve the Client of their obligations in this respect.

Intertek Testing Services NA Inc.
545 East Algonquin Road, Arlington Heights, IL 60005
Telephone 800-345-3851 or 847-439-5667 Fax 312-283-1672

Standard(s):	UL 651A - Schedule 40 And 80 High Density Polyethylene (HDPE) Conduit [UL 651A:2011 Ed.5 + R:24 Jun 2016]
Product:	Continuous Length HDPE Conduit
Models:	"EPEC-40", "Schedule 40", "EPEC-80" , "Schedule 80", and "EPEC-B"


CERTIFICATE OF COMPLIANCE

Certificate Number	UL-US-2324877-0
Report Reference	E528671-20230629
Date	4-Jul-2023
Issued to:	FRANKLIN FUELING SYSTEMS INC 3760 MARSH RD MADISON, WI 53718-6900 United States
This is to certify that representative samples of	DWTT - Conduit Fittings See Addendum Page for Product Designation(s). Have been evaluated by UL in accordance with the Standard(s) indicated on this Certificate.
Standard(s) for Safety:	UL 514B, 6th Ed., Issue Date: 2012-07-13, Revision Date: 2020-05-22
Additional Information:	See the UL Online Certifications Directory at https://iq.ulprospector.com for additional information

This Certificate of Compliance indicates that representative samples of the product described in the certification report have met the requirements for UL certification. It does not provide authorization to apply the UL Mark. Only the Authorization Page that references the Follow-Up Services Procedure for ongoing surveillance provides authorization to apply the UL Mark.

Only those products bearing the UL Mark should be considered as being UL Certified and covered under UL's Follow-Up Services.

Look for the UL Certification Mark on the product.


Deborah Jennings-Conner, VP Regulatory Services
UL LLC

Any information and documentation involving UL Mark services are provided on behalf of UL LLC (UL) or any authorized licensee of UL. For questions, please contact a local UL Customer Service Representative at <http://ul.com/aboutul/locations/>



CERTIFICATE OF COMPLIANCE

Certificate Number UL-US-2324877-0
Report Reference E528671-20230629
Date 4-Jul-2023

This is to certify that representative samples of the product as specified on this certificate were tested according to the current UL requirements

Model	Category Description
000-075-COUP-U	Fittings
000-075-NPT-U	Fittings
000-100-COUP-U	Fittings
000-100-NPT-U	Fittings

Deborah Jennings-Conner

Deborah Jennings-Conner, VP Regulatory Services

UL LLC

Any information and documentation involving UL Mark services are provided on behalf of UL LLC (UL) or any authorized licensee of UL. For questions, please contact a local UL Customer Service Representative at <http://ul.com/aboutul/locations/>

