

KIWA UPP® PIPE SYSTEM ACCESSORIES

Installations of UPP® pipework occurring in markets that require KIWA certifications of products will require specialized components. These components include an anti-permeation ring, a primary formed pipe bend, and pipe termination fitting.

SPECIFICATIONS

Approvals/Certifications


- KIWA certified.

Installation Components

- 1 Pipe termination
- 2 Anti-permeation ring
- 3 Formed pipe bend
- 4 Electrofusion coupler (standard)
- 5 Primary pipe (standard)
- 6 Pump cradle (locally supplied)

Anti Permeation Ring

For regions that command KIWA certification of products, KIWA BRL-K552/03 requires closure of the gap between pipe ends that are to be electrofusion welded for single wall primary pipe delivering fuel of PGS Class 1 and Class 2. To do this, an anti-permeation ring is installed between the pipe ends within the electrofusion coupler. Single wall primary pipe carrying PGS Class 3 fuel (e.g. diesel) does NOT require the anti-permeation ring to be fitted.

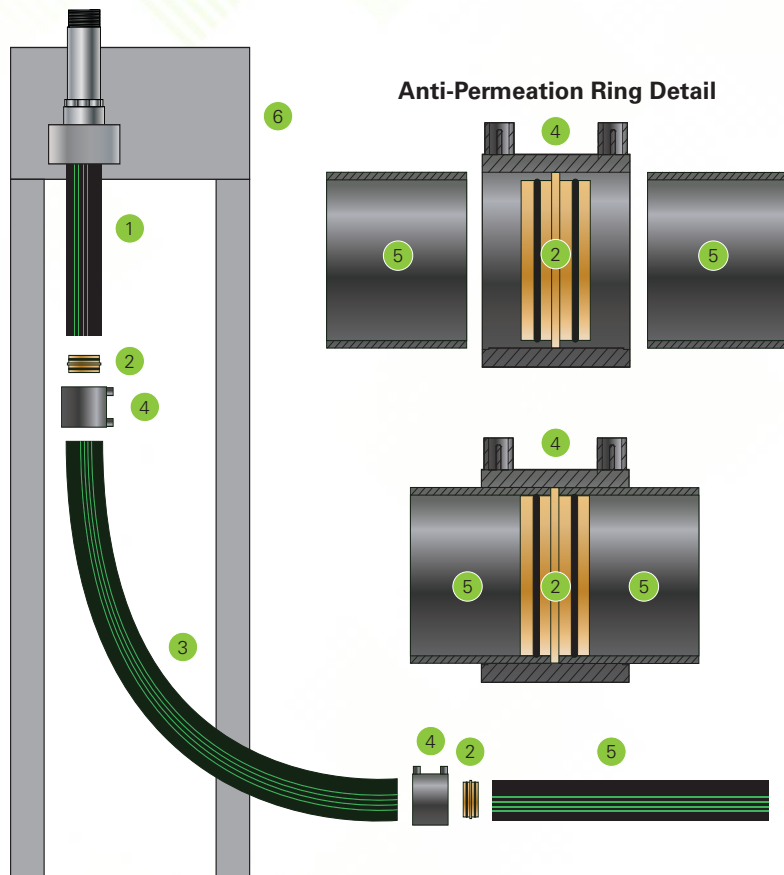

ORDERING INFORMATION



Model	Description
408185001	50mm Anti-Permeation Ring
408182001	63mm Anti-Permeation Ring



Model	Description
91-063-1-EXT-SS BSPT	63mm Piping Termination, 1 1/2" Male Thread BSPT



Model	Description
03-050-R400-K	50mm Piping Formed Bend, Single Wall
03-063-R400-K	63mm Piping Formed Bend, Single Wall



franklinfueling.com
 3760 Marsh Rd. • Madison, WI 53718, USA
 Tel: +1 608 838 8786 • Fax: +1 608 838 6433
 Tel: USA & Canada +1 800 225 9787 • Tel: UK +44 (0) 1473 243300
 Tel: Mex 001 800 738 7610 • Tel: DE +49 6571 105 308 • Tel: CN +86 10 8565 4566



© 2018 Franklin Fueling Systems, LLC. All Rights Reserved.