





ONE TOUCH BUTTONS

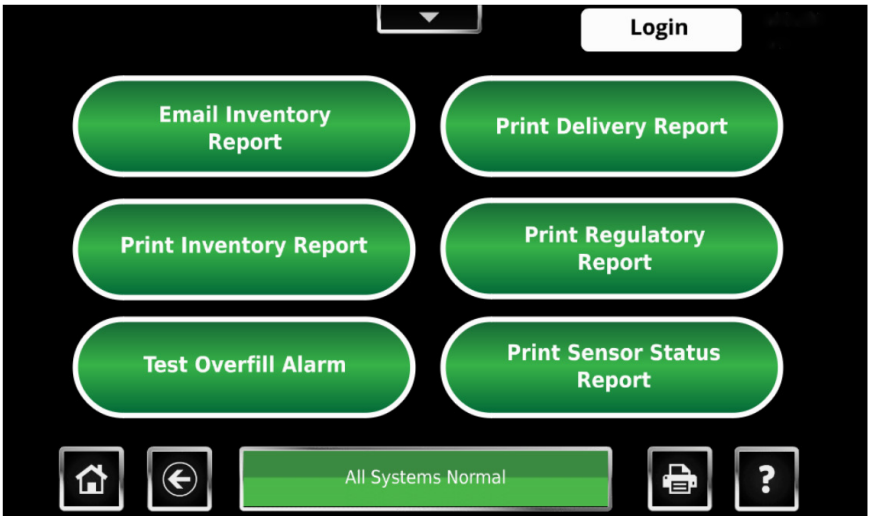

The One Touch Buttons are programmable shortcuts to perform specific console functions.

NOTE: Setup of the One Touch Buttons must be performed by a trained and certified technician.


NAVIGATION



- HOME:** Navigates to the home page as set in configuration.
- BACK:** Navigates to the previous screen.
- PRINT:** Prints information on current page or navigates to the reports page to print a selected report.
- HELP:** Displays context sensitive help information and has QR codes leading to product documentation and technical support.

QUICK JUMP MENU


From any screen, access the Quick Jump Menu (QJM) by clicking the down arrow at the top of the screen.

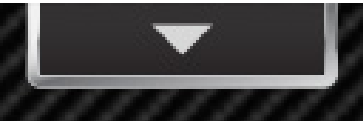

This will bring up the applicable applications.



SYSTEM STATUS BAR




The System Status Bar will be green and display All Systems Normal when the system has alarms.



The System Status Bar will be red and scroll through active alarms when the system has active alarms.

ALARMS: Select the System Status Bar at any time to view the Active Alarms screen.




CLEAR ACTIVE ALARMS: A certified technician can help diagnose alarm issues; record your Service Company’s contact information to contact in case of alarm.

TO DISPLAY

- Gross Volume
- Gross Level
- Product Temperature
- Net Volume
- Water Volume
- Water Level


Select to open the QJM.

Select to view the Tanks screen.

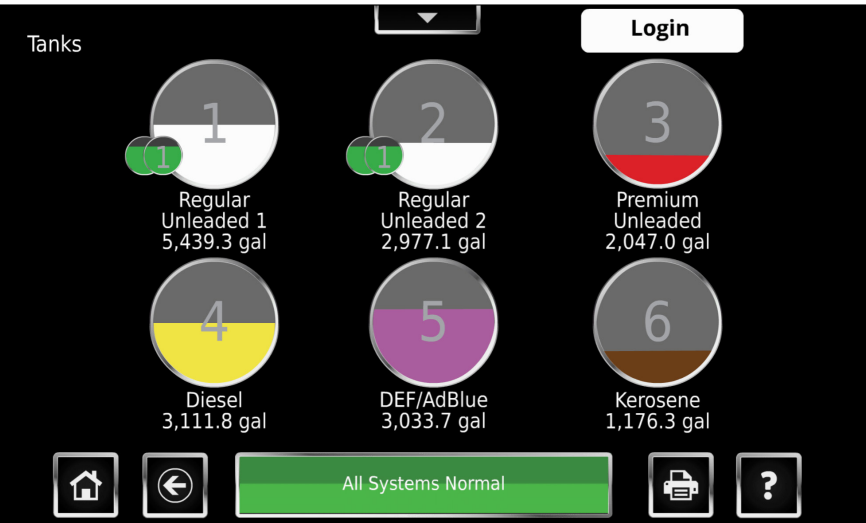

NOTE: Select the print button while on the Tanks screen to print an Inventory report for all tanks.

Select an individual tank for details about the tank.

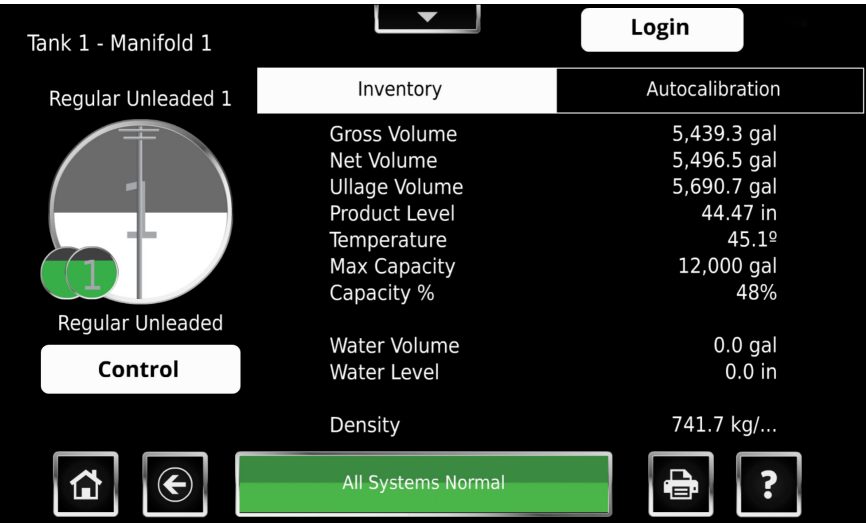




PASSWORD ENTRY

The EVO™ will prompt the user to enter a password when required to perform the selected function. Use the keyboard displayed to enter the correct password.

TO GENERATE REPORTS

Select  to open the QJM.

Select  to view the Reports screen.

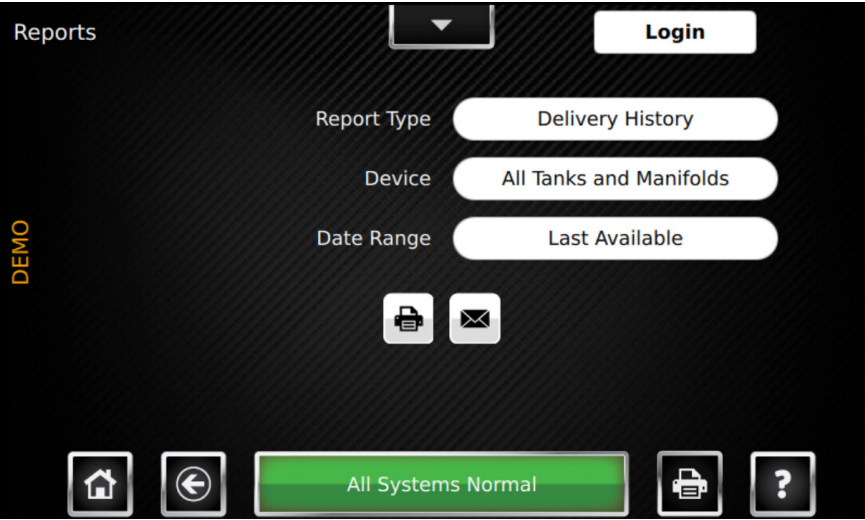

Select the delivery method:

-  **PRINT:** Will print report from selected printer.
-  **EMAIL:** Will email the report to the selected contact.


TO FORCE A TANK LEAK TEST

Select  to open the QJM.

Select  to view the Tanks screen.

Select an individual tank.

Select  to access the tank control menu.

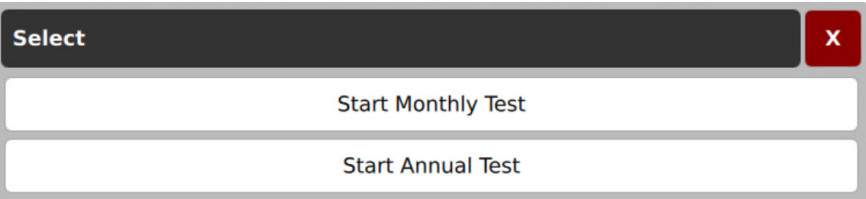

Select the desired test.


TO FORCE A LINE LEAK TEST

Select  to open the QJM.

Select  to view the Lines screen.

Select an individual line.

Select  to access the line control menu.

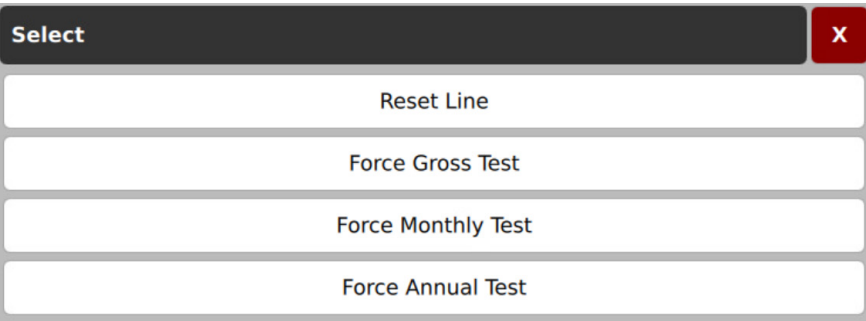

Select the desired test.

CONTACTS

Enter the service company's information below.

Name	Number

NOTE: Alarms cannot be cleared manually. Alarms will automatically clear when the condition that initiated the alarm has been corrected.

TECHNICAL SERVICES:
Franklin Electric Technical Support
Web: franklin-energy.com/support-center
Tel: +1 800 984 6266

For additional questions and concerns, please contact:
Franklin Electric
3760 Marsh Road, Madison WI 53718 USA

Web: franklin-energy.com
Tel: USA & Canada +1 800 225 9787 • **Tel: UK** +44 (0) 1473 243300
Tel: Mex 001 800 738 7610 • **Tel: DE** +49 6571 105380
Tel: CN +86 10 8565 4566